


WaterAlert Basic Threshold Alerting Examples


WaterAlert is designed to evaluate for threshold exceedance criteria on only the most recent data point within a transmission string. Typically four 15-minute data points are transmitted each hour.

WaterAlert will not send notifications more frequently than hourly.


Example Exceedance Threshold of 7 feet

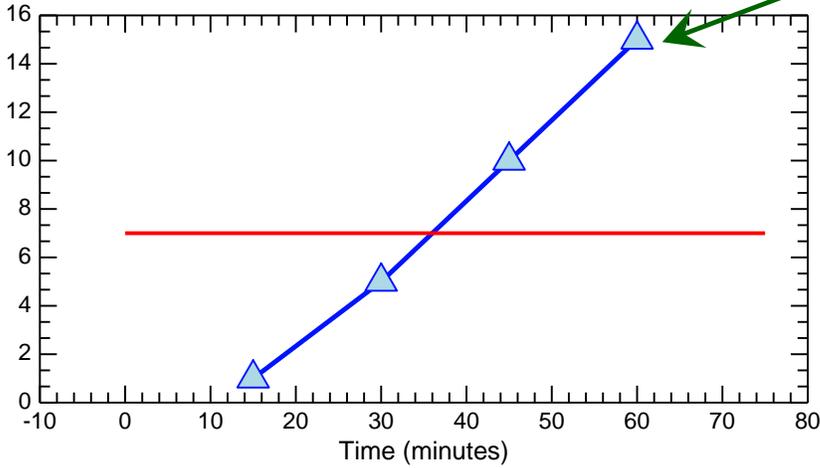


WaterAlert transmitted = YES

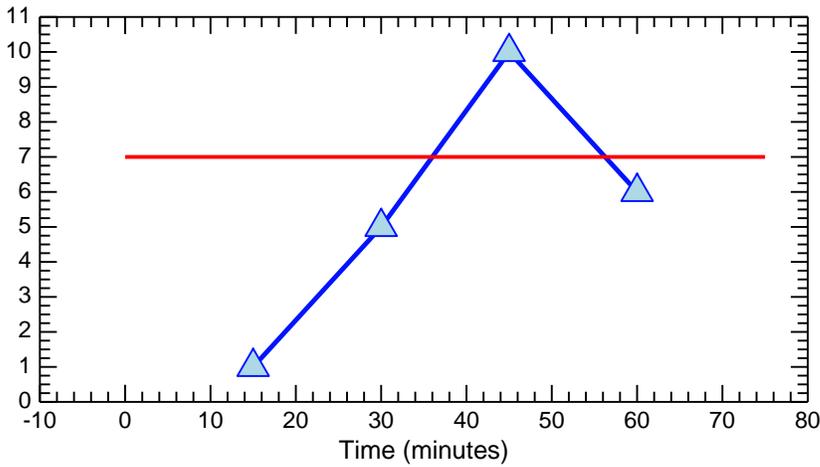

WaterAlert transmitted = NO

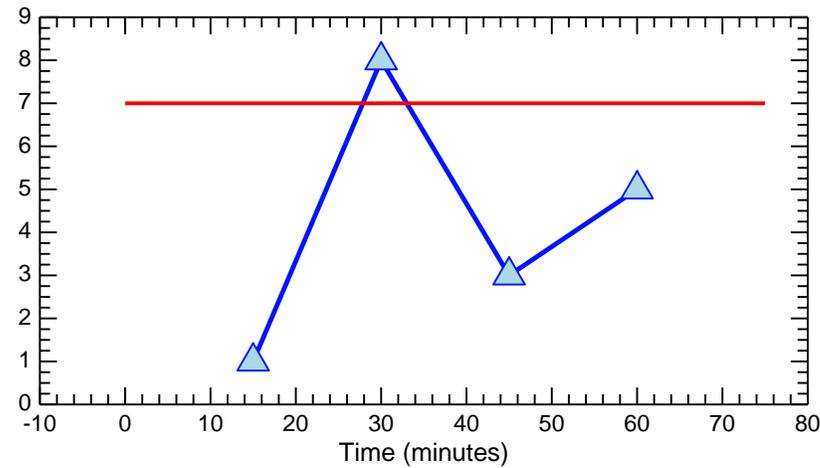

WaterAlert Transmitted = NO

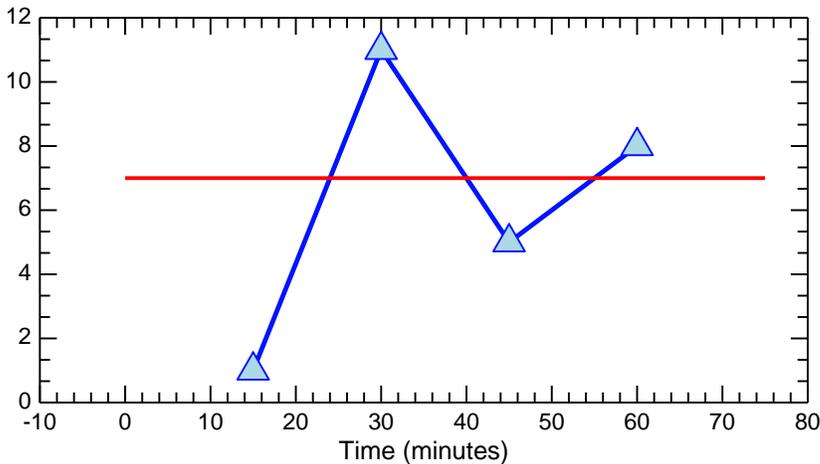

WaterAlert transmitted = YES
But an additional data value within the last hourly transmission, that exceeded the threshold by more than the most recent value, was not evaluated.